

Ductless Split Systems Ceiling Cassette Heat Pumps

PURCHASER	P.O. #	DATE
PROJECT	LOCATION	
ENGINEER	ARCHITECT	
SUBMITTED BY	FOR APPROVAL	FOR REFERENCE

ITEM	PLAN DESIGNATION	QUANTITY	COOLING BTU/H	VOLTAGE	FRIEDRICH MODEL

Features

- Inverter technology (variable speed compressor)
- Internal condensate pump included with up to 27-1/2" lift*
- Natural air flow
- 4-Way cooling
- Surge cool/heat
- Cooling/Heating/Fan mode



- Sleep mode
- Built-in low ambient standard, down to 14°F (Cooling mode)
- Independent vane control
- 5 Fan speeds
- Evaporator frost control
- 24-hour on/off timer
- Auto restart
- Auto changeover
- Temperature display on remote
- Ultra-quiet turbo fan
- DiamonGold Advanced Corrosion Protection™
- Clean, modern look
- Flexible installation
- ENERGY STAR® qualified models
- Precise air distribution
- BLDC Motors
- * Lift from drain pan to drain outlet. Use external drain pump for installations requiring condensate lift exceeding 27 1/2"

All Inverter line







MC24Y3J

MC36Y3J

NOTE: Grilles are sold separately



WIRELESS REMOTE CONTROL





MR24UY3J

MR36UY3J

Ductless_Ceiling_Cassette_Heat_Pumps_Submittal_2016

SPECIFICATIONS

PERFORMANCE RATINGS		Single Zone Cassette - Heat Pump		
		24k	36k	
SYSTEM MODEL NO.		C24YJ	C36YJ	
INDOOR MODEL		MC24Y3J	MC36Y3J	
OUTDOOR MODEL		MR24UY3J	MR36UY3J	
SPECIFICATIONS				
CAPACITY COOLING (RATED)	Btu	24,000	36,000	
CAPACITY COOLING (MIN~MAX)	Btu	9,700~26,700	14,000~42,000	
CAPACITY HEATING @ 47° F (RATED)	Btu	27,000	40,000	
CAPACITY HEATING @ 17° F (RATED)	Btu	18,600	26,000	
CAPACITY HEATING (MIN~MAX)	Btu	10,900~30,000	14,500~45,000	
COOLING AMPS	Dia	15.1	20.2	
HEATING AMPS		15.1	20.8	
SENSIBLE HEAT RATIO		.77	.76	
SEER		17.0	19.0	
EER		12.6	13.5	
HSPF		9.7 Va -	9.5	
ENERGY STAR *		Yes	Yes	
MOISTURE REMOVAL	Pts/h	5.1	7.7	
AIRFLOW (LOW, MED, HIGH)	CFM	459 / 530 / 600	918 / 989 / 1,060	
SOUND RATING - INDOOR H/M/L	dB(A)	38/36/34	46/44/43	
SOUND RATING - OUTDOOR	dB(A)	62	67	
OPERATING RANGE (COOLING)	°F	5~118	5~118	
OPERATING RANGE (HEATING)	°F	-4~64	-4~64	
EST. YEARLY OPERATING COST	\$	172	240	
ELECTRICAL DATA				
POWER SOURCE	V	208/230/60/1	208/230/60/1	
MINIMUM AMPACITY	А	18.1	24.5	
COOLING WATTS	W	1910	2970	
MAX. TD FUSE/BREAKER	А	30	40	
POWER AND COMMUNICATION CABLE	No. x AWG	4 x 14	4 x 14	
REFRIGERATION SYSTEM				
REFRIGERANT		R410A	R410A	
COMPRESSOR TYPE		Twin Rotary	Twin Rotary	
CONNECTIONS		Flare	Flare	
LIQUID LINE O.D.	in	3/8	3/8	
SUCTION LINE O.D.	in	5/8	5/8	
FACTORY PRECHARGE	ft	25	25	
REFRIGERANT CHARGE	OZ	71	120	
MIN./MAX. LINE LENGTH	ft	25~164	25~246	
MAX. HEIGHT DIFFERENCE	ft	98	98	
DIMENSIONS & WEIGHT				
WXHXD	in	33-1/16 x 8-1/16 x 33-1/16	33-1/16 x 11-3/8 x 33-1/	
NET WEIGHT	lbs	45	54	
SHIPPING WEIGHT	lbs	58	65	
INDOOR UNIT GRILLE** W X H X D	in	37-3/8 x 15/16 x 37-3/8	37-3/8 x 15/16 x 37-3/8	
INDOOR UNIT GRILLE** NET WEIGHT	lbs	11	11	
WXHXD	in	37-7/16 x 32-7/8 x 13	37-13/32 x 54-3/8 x 13	
NET WEIGHT	lbs	132	203	
SHIPPING WEIGHT	lbs	146	227	
TOTAL NET WEIGHT	lbs	178	257	
TOTAL SHIPPING WEIGHT	lbs	203	293	

Refrigeration line sets*

USED WITH	Length Ft.	Liquid	Suction	Kit#
9000 and 12000	15'	1/4"	3/8"	T32150
BTU indoor units	35'	1/4"	3/8"	T32350
	15'	1/4"	1/2"	T42150
18000 BTU indoor units	35′	1/4"	1/2"	T42350
24000,30000 and 36000	15'	3/8"	5/8"	T53150
BTU indoor units	35'	3/8"	5/8"	T53350

*Insulated line sets are available for all Friedrich split systems in 15 ft. and 35 ft. lengths. Each line set is equipped with flare nuts on both ends. Both liquid and suction lines are insulated. Line sets can be joined together with field supplied double male connectors. Each system requires one line set for each indoor unit installed. On multi-zone systems, line sets should be ordered based on individual indoor unit capacities not total system capacity.

Ceiling Cassette Grilles (required accessory)

DECORATIVE GRILLE	USED WITH
DCG2436	MC24Y3J, MC36Y3J models

Thermostat

WIRED CONTROLLER	
DWC1	
a militaria Brenzes	

Available for all models


Your operating costs will depend on your utility rates and use. The estimated operating cost is based on a electricity cost of \$.115 per kWh. For more information, visit www.ftc.gov/energy.


- *System meets ENERGY STAR[®] published minimums.
- **Models require grilled. Sold separately.


Due to continuing research in new energy-saving technology, specifications are subject to change without notice.



INDOOR UNITS / MC24Y3J

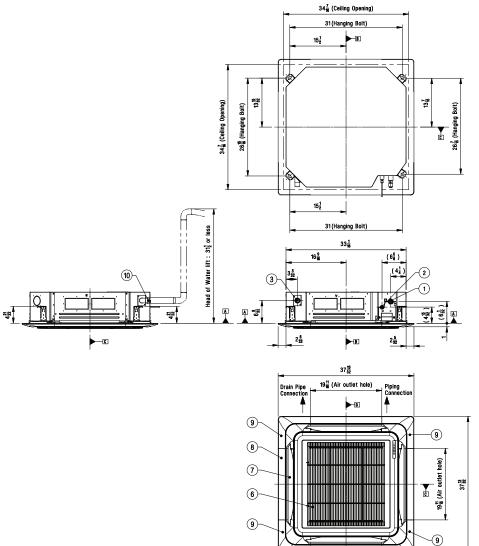





Symbols


Datum line

► Refrigerant/Drain Piping Direction

Item No.	Part Name	Description
1	Gas Pipe Connection	-
2	Liquid Pipe Connection	-
3	Drain Pipe Connection	-
4	Power and Communication cable routing whole	-
5	Wired remote controller wire routing hole	-
6	Air Inlet	-
7	Air Outlet	-
8	Decoration Panel (Accessory)	DCG2436
9	Decoration Corner Cover	Supplied with panel
10	Flexible Drain Hose	Supplied with product

- 1. Unit should be installed in compliance with the installation manual in the product box.
- 2. Unit should be grounded in accordance with the local regulations or applicable national codes.
- 3. All electrical components and materials to be supplied from the site must comply with the local regulations or international codes.
- Electric characteristics chapter should be considered for electrical work and design. Especially, the power cable and circuit breaker should be selected in accordance with that.

INDOOR UNITS / MC36Y3J

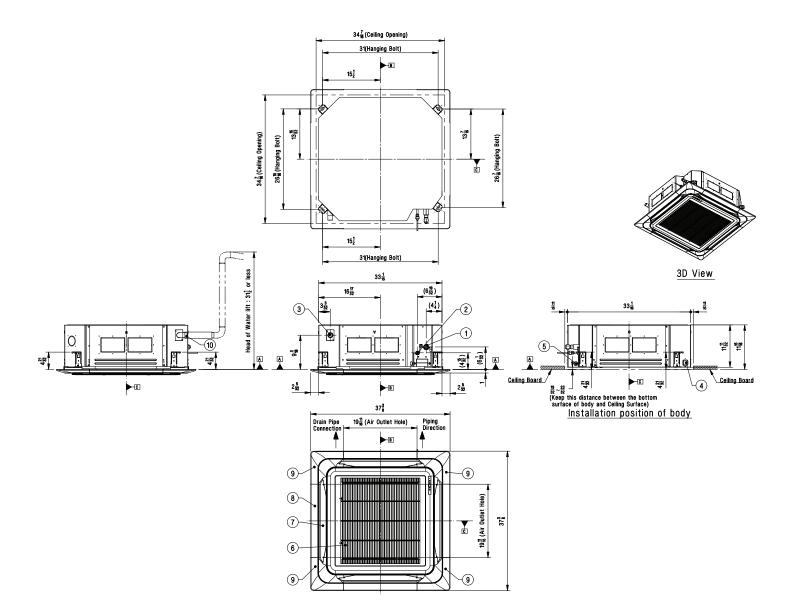

Symbols


Datum line

----> Refrigerant/Drain Piping Direction

Item No.	Part Name	Description
1	Gas Pipe Connection	-
2	Liquid Pipe Connection	-
3	Drain Pipe Connection	-
4	Power and Communication cable routing whole	-
5	Wired remote controller wire routing hole	-
6	Air Inlet	-
7	Air Outlet	-
8	Decoration Panel (Accessory)	DCG2436
9	Decoration Corner Cover	Supplied with panel
10	Flexible Drain Hose	Supplied with product

- 1. Unit should be installed in compliance with the installation manual in the product box.
- 2. Unit should be grounded in accordance with the local regulations or applicable national codes.
- 3. All electrical components and materials to be supplied from the site must comply with the local regulations or international codes.
- 4. Electric characteristics chapter should be considered for electrical work and design. Especially, the power cable and circuit breaker should be selected in accordance with that.

OUTDOOR UNITS / MR24UY3J

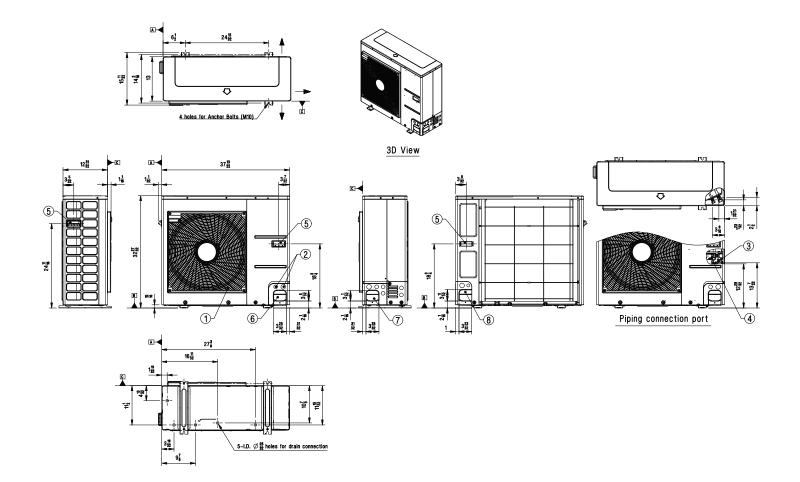

Symbols


A Datum line

Piping Direction

Item No.	Part Name	Description
1	Air Outlet	-
2	Power and communication cable hole	-
3	Gas Pipe Connection	Flare Joint
4	Liquid Pipe Connection	Flare Joint
5	Handle	-
6	Pipe routing hole (front)	-
7	Pipe routing hole (side)	-
8	Pipe routing hole (back)	-

- 1. Unit should be installed in compliance with the installation manual in the product box.
- 2. Unit should be grounded in accordance with the local regulations or applicable national codes.
- 3. All electrical components and materials to be supplied from the site must comply with the local regulations or international codes.
- Electric characteristics chapter should be considered for electrical work and design. Especially, the power cable and circuit breaker should be selected in accordance with that.

OUTDOOR UNITS / MR36UY3J

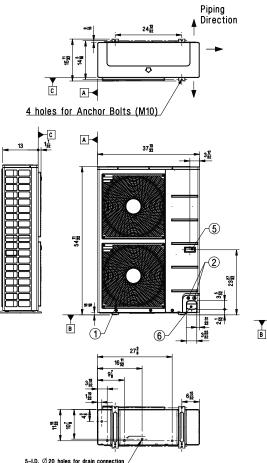





3D View

C-

-13





5–1.D. $ot {\oslash} 20$ holes for drain connection

Symbols

A Datum line

Piping Direction

Item No.	Part Name	Description
1	Air Outlet	-
2	Power and communication cable hole	-
3	Gas Pipe Connection	Flare Joint
4	Liquid Pipe Connection	Flare Joint
5	Handle	-
6	Pipe routing hole (front)	-
7	Pipe routing hole (side)	-
8	Pipe routing hole (back)	-

- 1. Unit should be installed in compliance with the installation manual in the product box.
- 2. Unit should be grounded in accordance with the local regulations or applicable national codes.
- 3. All electrical components and materials to be supplied from the site must comply with the local regulations or international codes.
- 4. Electric characteristics chapter should be considered for electrical work and design. Especially, the power cable and circuit breaker should be selected in accordance with that.